



MODEL FDD-A-S DYNAMIC FIRE DAMPERS

DYNAMIC CLOSURE MODEL W/ INTEGRAL SLEEVE — 1 1/2 or 3 HOUR

Standard Construction:

- Frame:** 12" Roll Formed Galvanized Steel.
- Blades:** Roll Formed Galvanized Steel, Curtain-Type
- Springs:** Stainless Steel.
- Fusible Link:** U.L. Listed 165°F, and 212°F available

Vertical Mount:

- Min. Size:** 6" w X 6" h (152 mm x 152 mm)
- Max. Single Section:** 18" w X 18" h (457 mm x 457 mm)
- Max. Size:** 36" w X 36" h (914 mm x 914 mm)

Horizontal Mount:

- Min. Size:** 6" w X 6" h (152 mm x 152 mm)
- Max. Size:** 24" w X 24" h (610 mm x 610 mm)

Maximum Velocity: 2000 fpm (10.2 m/s)

Maximum Pressure: 4" wg (1kPa)

Optional Construction:


- 14" - 16" Sleeve/Frame
- Fully Sealed Sleeves
- 3 Hour Rated
- 3/4" Flange (Sidewall Termination)

Notes: Sleeved Dampers are furnished approximately same size as given duct dimensions, unless otherwise noted.

"These Dampers are UL/ULC Approved for Use in Dynamic and Static Systems."

FDD-(V/H)AR-S

- * D = Duct Size Minus 1/4"
- * Maximum Diameter = 34" (863 mm)

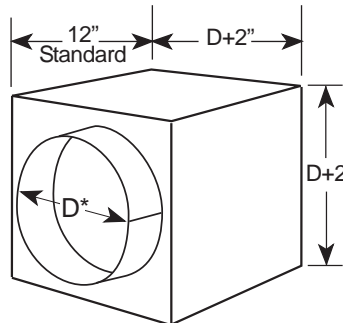

Manufacturer's Recommendations

All moving parts of the damper must be inspected and cycled at intervals not greater than 6-12 months the first year and then every 4 years after, or in accordance with the latest edition of NFPA 90A, 92A, local codes and the actuator manufacturer. In addition, fuse links shall be removed and inspected for corrosion. Dry lubricants are recommended.



Specifications are correct at time of printing. However, as part of our 'continuous improvement program,' we reserve the right to make further improvements without notice.

© 2007 NCA Manufacturing

FDD-VA-S

DESIGNED AND TESTED IN ACCORDANCE WITH UL-555 AND ULC-S112. MEETS ALL NFPA-90A REQUIREMENTS FOR FIRE DAMPERS.

LISTED AND LABELLED BY:

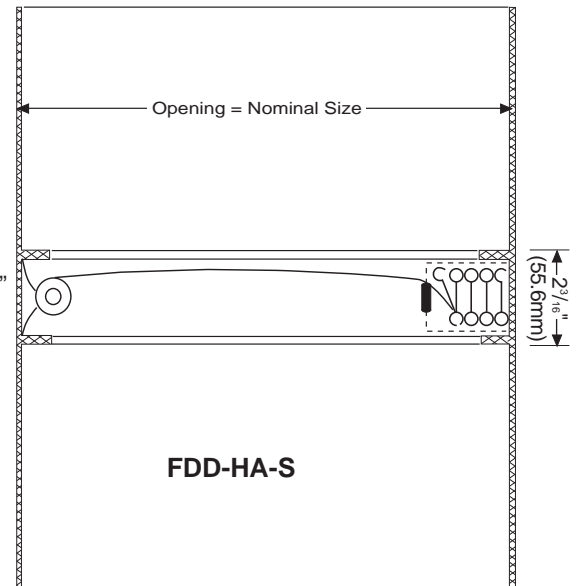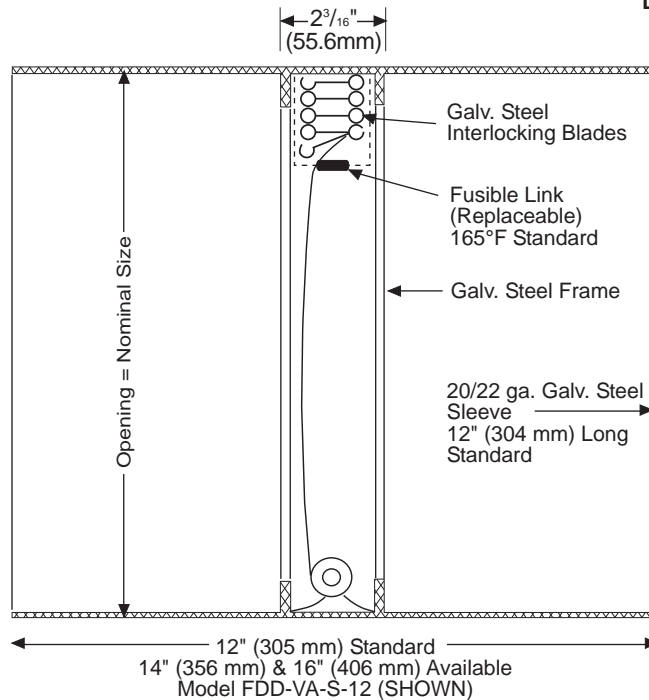

FDD-A-S - 07-07

Project:

Contractor:

Location:

Address:

Architect:

P.O. Number:

Engineer:

Date: